

# Performance Analysis of DFIG Wind Turbine during Fault Conditions

**Dhananjay Kumar, Shashikant Soni**

Department of Electrical & Electrical Engineering,  
Rabindranath Tagore University Bhopal M.P.

**Abstract:** Wind power plants often located in remote areas are characterized by weak grids and they are frequently subjected to power system disturbance like voltage sag, short circuit fault and dynamic loading. This paper presents a study of the dynamic performance of variable speed DFIG-coupled wind turbine plant under power system disturbance. Modelling and simulation of induction machines, power system components and controller design is done using MATLAB. Vector control approach is being implemented in MATLAB/SIMULINK platform for DFIG active, reactive power control, and variable speed operation. Results obtained from simulation are enumerated and verified from literature.

**Keywords:** Double fed induction generator (DFIG), vector control, voltage dip, MATLAB/SIMULINK

## 1. Introduction

Nowadays, the large scale wind farms are required to be controllable both in active and reactive power, and to have the low voltage ride through capability when disturbances in grid. Because of its ability to provide variable speed operation and independent active and reactive power control in a cost effective way, the doubly fed induction generator (DFIG) has the largest world market share of wind turbine concepts since last 10 years [1]-[2]. Many researchers have studied the low voltage ride through capability of DFIG [3]-[7], most of them are focused on the behaviours and protections of DFIG under fault conditions.

Squirrel cage induction machine and variable speed double fed induction generators are widely used for Wind Energy conversion system. Recently DFIG find increasing application in wind-turbine generation. DFIG shown in fig. (1) has the ability to control the active and reactive power and maintain constant frequency operation. With wind speed variation or under power system disturbance, the injected rotor voltage, current or the frequency of the injected rotor voltage can be controlled to achieve constant frequency, stable operation at the stator or grid side. Induction machines are particularly sensitive to unbalanced operation, since localized heating can occur in the stator and lifetime of the machine can be severely affected. Furthermore, negative sequence currents in the machine produces pulsation in the electrical torque, increasing the acoustic noise and reducing the life span of gear box, blade assembly and some parts of wind turbine. Therefore, proper protection system and controller should be designed for faulty and voltage dip operation.

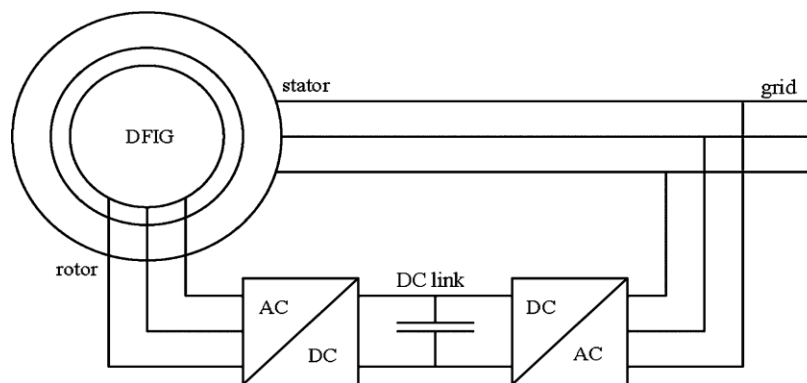


Fig. (1) Double fed induction machine

This study deals with power system transient stability and dynamic load behaviour analysis. The present investigations are dealing with (i). Wind turbine dynamic modeling, (ii). Steady state and free acceleration characteristics of DFIG (iii). DFIG interaction with power systems, (iv). DFIG current control, (v). Active and reactive power and damping control (vi) THD analysis of stator voltage and current. DFIG can operate in both sub-synchronous and super-synchronous operation mode to impart power to the grid or from the grid with a minimum rotor power input in both steady and variable speed wind turbine operation mode.

## 2.1 Dynamic Modelling of wind turbine

A wind turbine mathematical modeling contains basic functional components like wind turbine aerodynamic model, wind-turbine drive train model, DFIG model interfaced with a converter in the rotor side, electric grid model and the controller design.

### 2.1.1 Wind Turbine

The aerodynamic modelling of wind turbine estimated from its power-speed characteristics. Steady state mechanical power output is given by:

$$P_m = \frac{1}{2} \rho A C_p u^3 \quad (1)$$

Where  $C_p$  is the power co-efficient depends on turbine design and can be updated from look up table each time. In general turbine and generator are modeled as two mass systems and the coupling flexible shaft is being modeled as a spring in equivalent mechanical system. In this two mass spring damper modeled, each component is being characterized by its own inertia ( $J_t, J_g$ ), friction damping ( $D_t, D_g$ ) and stiffness constant ( $K_{sh}$ ) and then all the model parameters are variables are referred to turbine side. Then, the governing equation describing the mechanical system is:

$$T_t - K_{sh}(\theta_t - \theta_g) - D_t \omega_t = J_t \frac{d\omega_t}{dt} \quad (2)$$

$$K_{sh}(\theta_t - \theta_g) - T_g - D_g \omega_g = J_g \frac{d\omega_g}{dt} \quad (3)$$

$$K_{sh}(\theta_t - \theta_g) = T_g \quad (4)$$

## 2.2 Pitch angle controller Design

For variable speed wind turbine, pitch angle control is essential for accurate modelling and simulation studies. The main function of Pitch angle control is to provide suitable speed and power limit for smooth turbine operation and to contribute maximum wind energy capture. As described in subsection-1, in order to maximize the maximum output power,  $C_p$  is dependent upon wind speed and rotor data and can be adjusted by controlling the pitch angle ( $\beta$ ). The wind and rotor data will define the possible power available limit ( $P_s$ ). Now, the pitch angle controller adjusts the  $\beta$  value to limit the ( $P_s$ ) to ( $P_{rated}$ ). The pitch angle control is realized by a PI controller. This model accounts for a servo time constant ( $T_s$ ) and a limitation of both pitch angle and its rate of change.

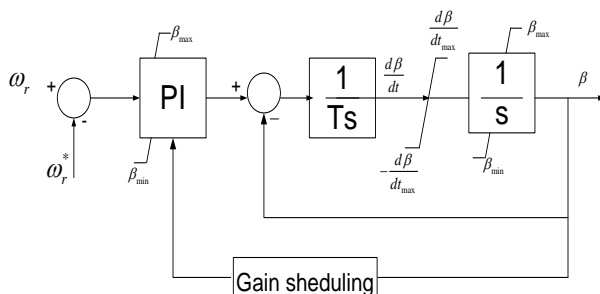


Fig. (2) Pitch angle controller design

## 2.3 DFIG Modeling

In order to improve the quality and controllability of the generated electrical power, wind turbine with a doubly fed induction generator is preferred [8]-[9]. Here the converter connected to the rotor winding is of lower rating. The filter required for power factor control is also of lesser rating. However, the major drawback of this configuration is their operation during grid fault. For, analysis an accurate numerical modeling of DFIG must be provided to find out the dynamic performances [10]. Here, stator side is directly connected to the grid while rotor is interfaced with the converter and rotor current is being sensed for control operation[11]. The controllability of DFIG (i.e., variable speed operation, active and reactive power control) is achieved through rotor current control applying vector control technique. In order to provide a decoupled control action, first the induction machine is modelled in d-q reference frame (park model) rotating at synchronous speed [12]. Using, the generator convention, the governing equations are as such:

$$v_{qs} = -R_s i_{qs} + \frac{d}{dt} \psi_{qs} + \omega_e \psi_{ds} \quad (5)$$

$$v_{ds} = -R_s i_{ds} + \frac{d}{dt} \psi_{ds} - \omega_e \psi_{qs} \quad (6)$$

$$v_{qr} = -R_r i_{qr} + \frac{d}{dt} \psi_{qr} + \omega_e \psi_{dr} \quad (7)$$

$$v_{dr} = -R_r i_{dr} + \frac{d}{dt} \psi_{dr} - \omega_e \psi_{qr} \quad (8)$$

In order to represent all the variables in a common reference frame the  $\theta_s, \theta_r, \omega_r$  and the co-efficient of mutual coupling is fed back as the input along with machine parameter. The machine variables expressed in common reference frame has taken from [5].

The air gap flux linkage can be expressed as:

$$\psi_{qm} = L_m (i_{qs} + i_{qr}) \quad (9)$$

$$\psi_{dm} = L_m (i_{ds} + i_{dr}) \quad (10)$$

and the electromagnetic torque developed by the machine is given by:

$$T_e = (\psi_{qm} i_{dr} - \psi_{dm} i_{qr}) \quad (11)$$

Then re-arranging the voltage variable equations and representing them in state space form all the current variables can be evaluated at each instant. Subsequent rotor speed and electromagnetic torque can also be estimated. Approximating  $R_s$  to be negligible and  $\frac{d\psi_{ds}}{dt} = 0$  under steady state, then  $v_{ds}$  is in phase and proportional to  $\psi_{qm}$ , while  $v_{qs}$  is in phase and proportional to  $\psi_{dm}$  then if  $v_{ds}$  is in phase and proportional to  $v_{ds}$  is set to zero flux  $\psi_{qm}$  vanishes. Then, the developed torque and reactive power reduced to  $T_e = \psi_{dm} i_{qr}$  and  $Q_s = \frac{L_s}{L_m} \psi_{dm}^2 - \psi_{dm} i_{dr}^2$ . From, those expressions it is found that active and reactive power can be controlled by rotor injected voltage.  $i_{dr}$  and  $i_{qr}$  errors are processed by a PI controller to give desired  $v_{dr}$  and  $v_{qr}$ .

In the above equations  $v_{ds}, v_{qs}, v_{dr}, v_{qr}, i_{ds}, i_{qs}, i_{dr}, i_{qr}, \psi_{ds}, \psi_{qs}, \psi_{dr}$  and  $\psi_{qr}$  are the  $d$  and  $q$  components of the stator and rotor voltages, currents.

### 2.4 Rotor side Controller design

DFIG is a wound rotor induction motor with stator winding directly connected to the grid whereas rotor side is connected with a VSC. However, the converter supplies or absorbs reactive power to the DFIG depends its operation either at super or sub-synchronous mode. Neglecting the stator and rotor losses, expression of power at different nodes of the system is given as:

$$P_{rotor} = sP_{stator}; P_{stator} = \frac{1}{1-s} P_{grid} = \frac{\eta_g P_m}{1-s}$$

Here  $P_m$  is the mechanical output of turbine. So, from the rotor variable and rotor speed  $P_{stator}$  or  $P_{grid}$  can be obtained. Then active and reactive power control can be achieved in the following manner. Reactive power controller operates in automatic voltage regulator mode. The reference current  $I_{rq}^{ref}$  and  $I_{rd}^{ref}$  are restricted within the converter current rating. The injected voltage at the rotor side is also restricted so as not exceed the maximum rotor side converter voltage rating.

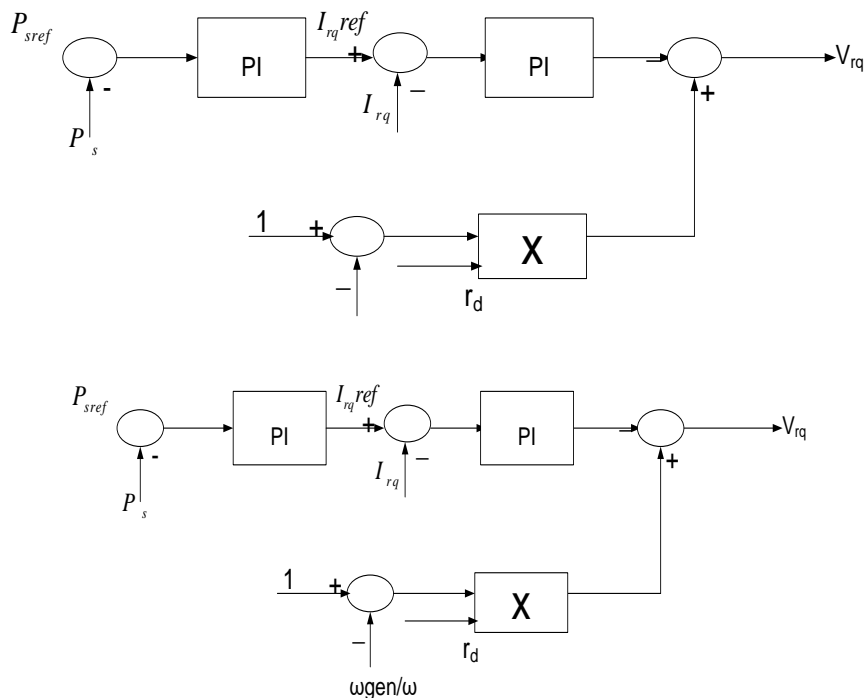
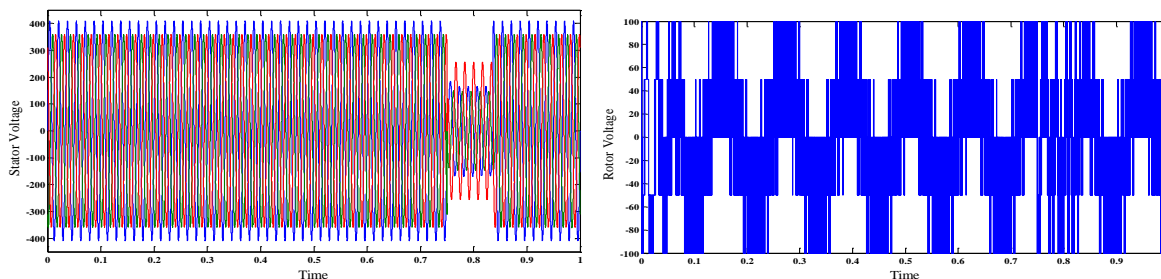


Fig.(3) active and reactive power controller

In normal operation, the active power set point  $P_{ref}^{grid}$  is defined from maximum power tracking curve and generator speed. Whereas under fault  $P_{ref}^{grid}$  is changed to the output value of damping controller. One damping controller is introduced to damp out torsional oscillation aroused due to drive train system.

### 3. Simulation Results

The dynamic response and transient performance of DFIG is evaluated under different fault and operating conditions and the voltage ride-through capability of the turbine is studied. Here, a DFIG –wind plant of 2 KVA Capacity is studied for analysis. Only rotor side converter along with the controller is used to control the machine speed and the reactive power supplied through the machine stator so as to maintain the nominal terminal voltage. Two cases of grid disturbance: (1). voltage sag (10%), (2). short circuit fault condition has been taken for analysis. The dynamic responses of variables (like, current, voltage, power speed and torque) for voltage sag and short circuit condition are shown in fig. 4 and fig. 5 respectively.



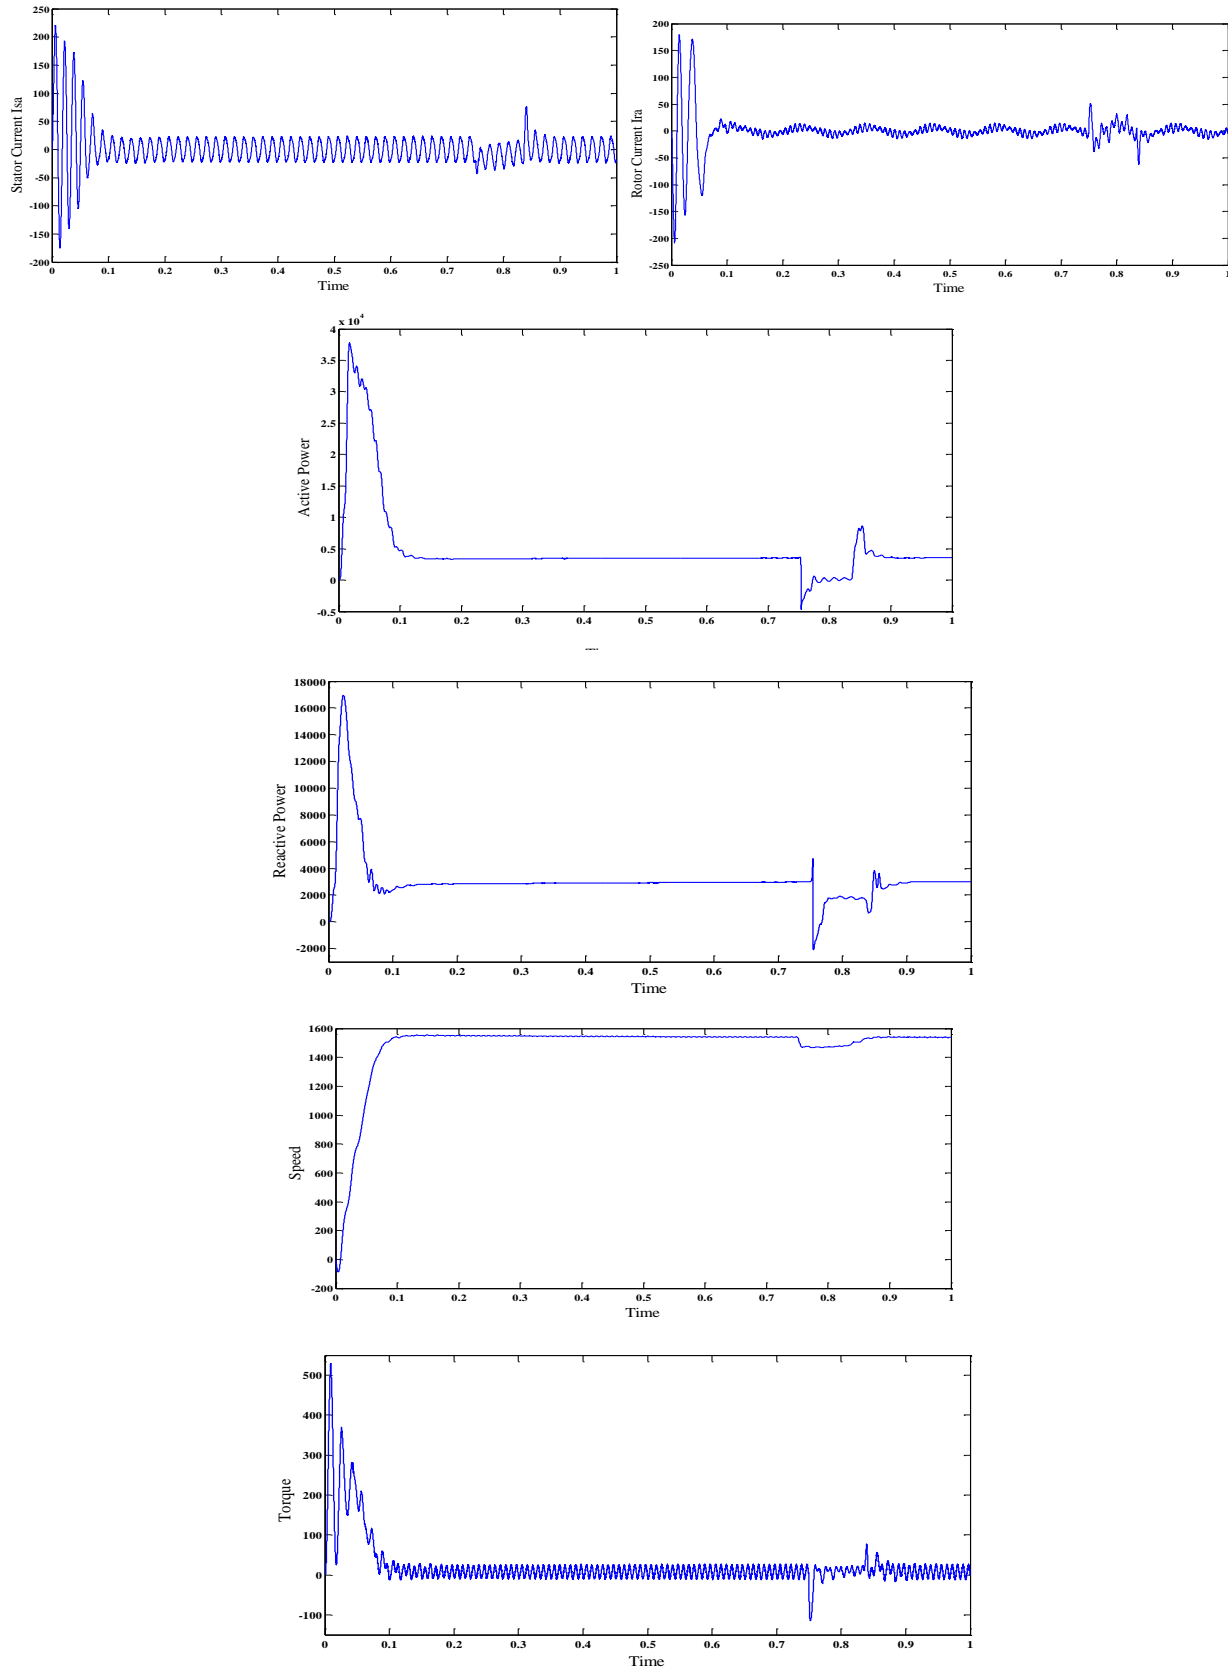


Fig.(4) DFIG during voltage sag

Under voltage sag, stator flux has been reduced which in turn increases the rotor current (1.2 p.u.), but the variations are within allowable range of converter and machine. After clearance of sag, again retain back to normal steady state value. The voltage sag period is from 0.26 to 0.335 seconds observed in fig. 4.

#### 4. Conclusion

In this paper a variable speed wind generation system based on DFIG under power system disturbance has been simulated and a suitable controller is designed to supply the deficit reactive power to the grid and help in grid recovery. By as the generator and converter stay connected, the synchronism of operation remains established during and after the fault and normal operation can be continued immediately after the fault has been cleared. Here the reactive power is being supplied to the grid during longer duration voltage dips in order to facilitate voltage restoration. Proper controller designed is adopted to improve the transient and dynamic performance of DFIG coupled Wind turbine under these abnormal grid conditions. This paper analyzes the DFIG dynamic behaviour and control possibility under grid disturbances like fault and large voltage dips etc. In this model, with the help of only one rotor side converter we are able to control the active and reactive power and maintain the stability of grid under faulty conditions.

#### REFERENCES

- [1] Ned Mohan, Ted K. A. Brekken "Control of a Doubly Fed Induction Wind Generator Under Unbalanced Grid Voltage Conditions" IEEE Transaction Energy conversion, vol.no22. 1, march 2007 page 129-135.
- [2] M. E. Hossain, "Performance of new solid-state fault current limiter for transient stability enhancement of DFIG based wind generator," *2017 North American Power Symposium (NAPS)*, Morgantown, WV, USA, 2017, pp. 1-6
- [3] R. Hiremath and T. Moger, "Comparison of LVRT Enhancement for DFIG-Based Wind Turbine Generator with Rotor-Side Control Strategy," *2020 International Conference on Electrical and Electronics Engineering (ICE3)*, Gorakhpur, India, 2020, pp. 216-220.
- [4] A. Parida and M. Paul, "A Novel Modeling of DFIG Appropriate for Wind- Energy Generation Systems Analysis," *2022 IEEE 10th Power India International Conference (PIICON)*, New Delhi, India, 2022, pp. 1-6.
- [5] C. Tiwary and K. Thakre, "Comparative Analysis of Conventional and Neutral Point Clamped Converter Topology for UPQC," *2022 IEEE 2nd International Symposium on Sustainable Energy, Signal Processing and Cyber Security (iSSSC)*, Gunupur, Odisha, India, 2022, pp. 1-6,
- [6] K. Thakre, K. B. Mohanty, H. Ahmed and A. K. Nayak, "Modified Cascaded Multilevel Inverter with Reduced Component Count," *2017 14th IEEE India Council International Conference (INDICON)*, Roorkee, India, 2017, pp. 1-5
- [7] P. N. Jaiswal, K. Thakre and P. Nigam, "Comparison of DSTATCOM, DVR and UPQC for Mitigating Voltage Sag in Distribution System," *2022 IEEE 2nd International Symposium on*

*Sustainable Energy, Signal Processing and Cyber Security (iSSSC)*, Gunupur, Odisha, India, 2022, pp. 1-6

- [8] A. Chatterjee, K.B. Mohanty, V.S. Kommukuri, K. Thakre; Power quality enhancement of single phase grid tied inverters with model predictive current controller. *Journal of Renewable and Sustainable Energy* 1 January 2017; 9 (1): 015301
- [9] Akhmatov, “Analysis of dynamic behavior of electric power systems with large amount of wind power”, PhD thesis of Electrical power engineering, ISBN: 87-91184-18-5, Technical University of Denmark, April, 2003.
- [10] Y. Zhou, P. Bauer “Control of DFIG under Unsymmetrical Voltage dips” Power Electronics Specialists Conference, 2007. PESC 2007. IEEE 17-21 June 2007 Page(s):933 – 938
- [11] M. P. Richwine, J. J. Sanchez-Gasca, and N.W. Miller, “Validation of a second generation type 3 generic wind model,” in Proceedings of IEEE PES General Meeting | Conference & Exposition, National Harbor, MD, USA, 2014, pp. 1–4.
- [12] Y.-C Zhang, E. Muljadi, D. Kosterev, and M. Singh, “Wind power plant model validation using synchrophasor measurements at the point of interconnection,” *IEEE Transactions on Sustainable Energy*, vol. 6, no. 3, pp. 984–992, Jul. 2015.